


MINIMUM CLEARANCE REQUIREMENTS FOR VAULTS

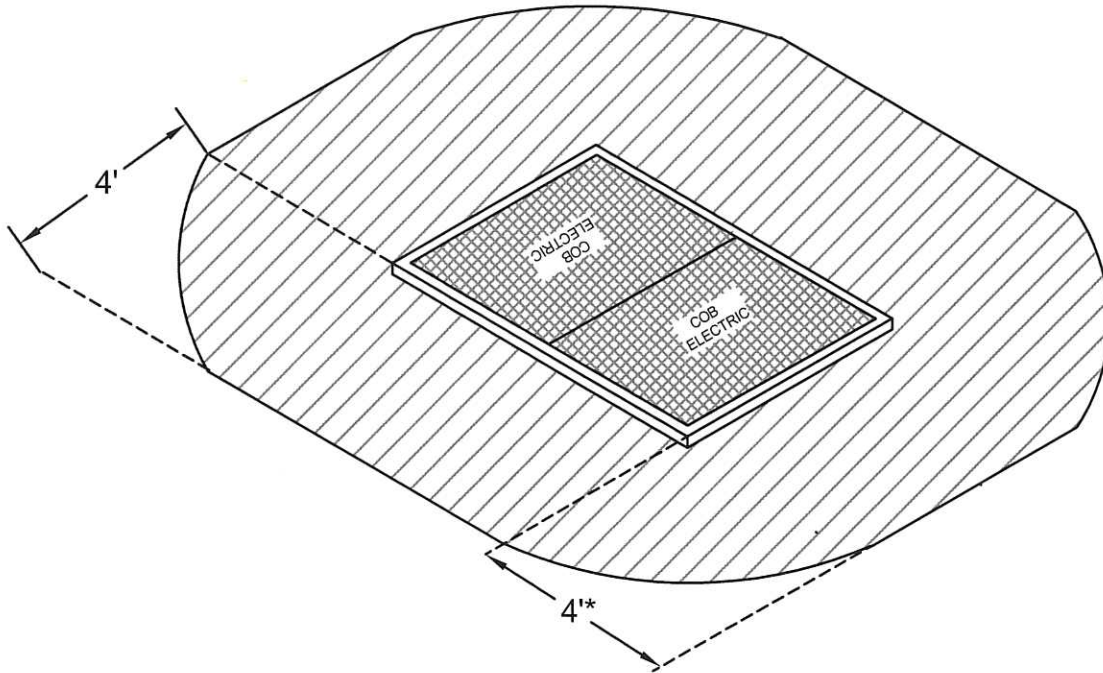

\* INCREASE CLEARANCE WIDTH TO 5 FEET FOR ANY WET UTILITY STRUCTURE INCLUDING FIRE HYDRANTS, STAND PIPES, ABOVE GROUND WATER METERS, AND BACK FLOW VALVES.

NOTES:

1. ALL SIDES OF THE VAULT MUST HAVE A MINIMUM OF 4 FEET RADIAL CLEARANCE.
2. MAXIMUM OF 2% SLOPE FREE AND CLEAR OF BUILDINGS, FENCES, BUSHES, TREES, PLANTS, SIDEWALKS, AND CURBS 5 FEET FROM STRUCTURE SLAB.
3. THE 4 FEET OF CLEARANCE CAN NOT BE IN A PARKING STALL. THIS DISTANCE MUST ALWAYS BE CLEAR.
4. NO CARPORTS ARE ALLOWED OVER ANY EQUIPMENT.
5. SUITABLE SPACE SHALL BE PROVIDED AND MAINTAINED ABOUT ELECTRICAL EQUIPMENT TO PERMIT READY AND SAFE OPERATION AND MAINTENANCE. A 12-FOOT WIDE PATH MUST BE AVAILABLE FOR SERVICE TRUCKS.
6. THE CLEARANCE SHOWN SHALL BE KEPT AT ALL TIMES. C.O.B. ELECTRIC RESERVES THE RIGHT TO REMOVE ANY PLANTS, TREES, SHRUBS, ETC. THAT INTERFERE WITH WORKING CLEARANCES.



REVISED: 08/07/2019

APPROVED: *[Signature]*

STANDARD DRAWINGS

MINIMUM CLEARANCE  
REQUIREMENTS  
FOR VAULTS

**SD**

600-72